


PREVIEW OF RESULTS

Client: DYNAMOBEL
Date of test: 13th of January, 2016
Complete results are available to the client



Test carried out by
LGAI Technological Center S.A.

Measurement of airborne sound insulation according to EN ISO 10140-2

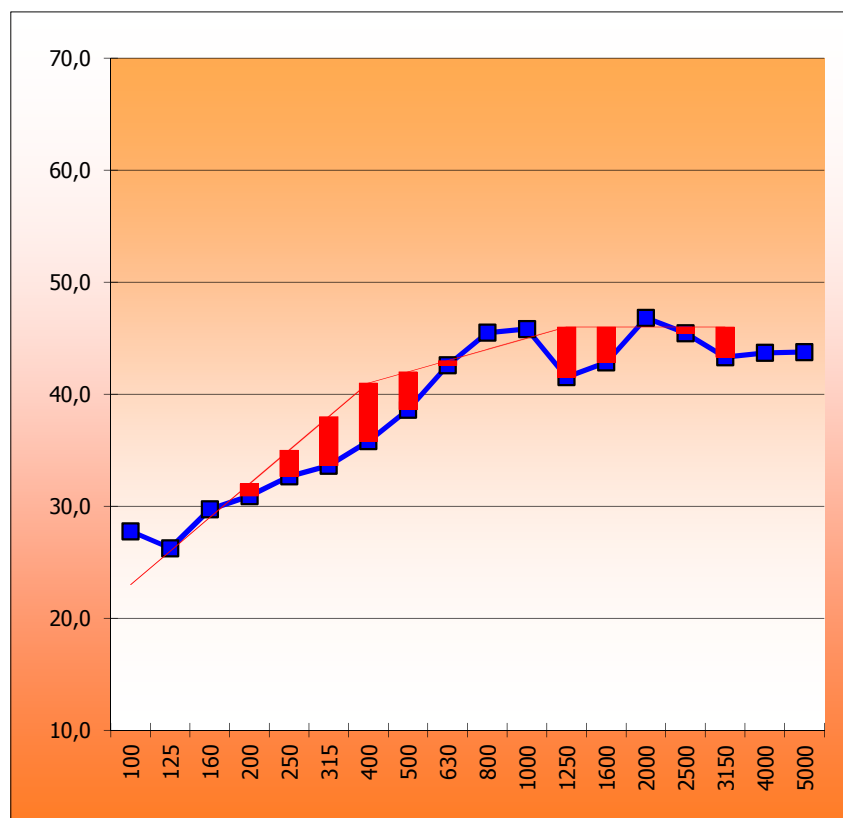

Frequency Hz	R
100	27,8
125	26,2
160	29,7
200	30,9
250	32,7
315	33,6
400	35,8
500	38,6
630	42,6
800	45,5
1000	45,8
1250	41,5
1600	42,8
2000	46,8
2500	45,4
3150	43,3
4000	43,7
5000	43,8

Test element description:

LINE CRYSTAL 2 GLASSES PARTITION

Glazed internal partition composed of double laminated glass pane 5+5 and aluminium profiles framing system.



WEIGHTED SOUND REDUCTION INDEX, R_w (C; C_{tr})

42 (-1; -4) dB